

Scottish Health Technical Memorandum 57

SHTM Building Component Series
Internal Glazing

Contents

	<i>Page</i>
1. Introduction	3
1.1 Background.....	3
1.3 Scope and status	3
1.9 Relationship to other data	4
1.14 Terminology	5
2. Design and specification guidance	6
2.1 General	6
2.3 Description of units	6
2.5 Glazing.....	6
2.25 Finishes.....	8
2.32 Observation.....	10
2.35 Safety, strength and security.....	10
2.56 Fire precautions	13
2.69 Sound insulation	14
2.74 Hygrothermal performance	14
2.78 X-ray resistance	15
2.81 Maintenance manual.....	15
References.....	16

Disclaimer

The contents of this document are provided by way of general guidance only at the time of its publication. Any party making any use thereof or placing any reliance thereon shall do so only upon exercise of that party's own judgement as to the adequacy of the contents in the particular circumstances of its use and application. No warranty is given as to the accuracy, relevance or completeness of the contents of this document and Health Facilities Scotland shall have no responsibility for any errors in or omissions therefrom, or any use made of, or reliance placed upon, any of the contents of this document.

1. Introduction

Background

1.1 This is one of a series of Scottish Health Technical Memoranda which provides specifications and design guidance on building components for health buildings.

A [Reference Section](#) is provided at the end of this document, including Acts and Regulations, NHS Resources and British Standards.

1.2 The numbers and titles of the SHTMs in the series are:

- 54 User manual;
- 55 Windows;
- 56 Partitions;
- 57 Internal glazing;
- 58 Internal doorsets;
- 59 Ironmongery;
- 60 Ceilings;
- 62 Demountable storage system;
- 63 Fitted storage system;
- 64 Sanitary assemblies;
- 66 Cubicle curtain track;
- 67 Laboratory fitting out systems;
- 69 Protection.

Scope and status

1.3 This SHTM offers guidance on the technical design and output specifications of internal glazing suitable for health buildings including:

- glazed partitions;
- observation windows;
- borrowed lights;
- fanlights and side lights to doorsets.

- 1.4 Vision panels in door leaves and half-glazed door leaves are described in SHTM 58: 'Internal doorsets', however, the guidance in [paragraphs 2.5–2.23](#) and [2.35–2.70](#) of this SHTM generally applies to these panels.
- 1.5 Requirements for balustrades are given in section 4 of the Building (Scotland) Regulations 2004. [Paragraphs 2.5–2.23](#) and [2.35–2.69](#) of this SHTM apply generally.
- 1.6 This guidance is not intended to cover the requirements for glazing to internal windows of atria, or similar constructions, internal roofs or canopies. These constructions can be extremely complex, with varying requirements for strength, safety, operation and fire resistance. Each case must be treated individually. Regulating authorities, technical experts and manufacturers should be approached early in the design process.
- 1.7 The content of this SHTM does not diminish either the manufacturer's responsibility for fitness for purpose of products or the design team's responsibility for selection and application of products to meet project requirements. Design teams are also reminded of their obligations under the Construction, Design and Management (CDM) Regulations 1994 (as amended 2000) to ensure safe construction.
- 1.8 All new glazing and replacement glazing in existing buildings should be in accordance with the provisions of this SHTM.

Relationship to other data

- 1.9 The main sources of data used in the preparation of this SHTM are listed in the [References Section](#).
- 1.10 This SHTM was prepared for publication in December 2006. After this date, readers should ensure that they use the latest or new edition of all building legislation, British Standards etc, which may post-date the publication of this document.
- 1.11 First preference should be given to products and services from sources which have been registered under current BSI Quality Assurance procedures or other certification schemes. Suppliers offering products other than to British Standards should provide evidence to show that their products are at least equal to such Standards.
- 1.12 This guidance should be used in conjunction with sections of the National Building Specification (NBS) relevant to glazing. NBS is a library of standard specification clauses covering most kinds of building work and comprising a wide range of clauses with accompanying guidance notes. All clauses are optional, and their combination into a job specification is left to the specifier.

NBS has great flexibility, and it can be adapted to suit the technical needs and preferences of different projects, organisations and specifiers. Specifications go out of date as a result of technical innovation or major review of a key BSI

document. As NBS sections become affected by such major changes, they are re-issued to members of the subscription service. Users are advised to ensure that they refer to the current edition. Refer to the NBS website at www.thenbs.com

- 1.13 Any enquiries regarding the technical content of this SHTM should be e-mailed to enquiries@hfs.scot.nhs.uk

Terminology

- 1.14 In this SHTM the following definitions apply:

- Internal glazing – the use of glazing in internal situations generally (for vision panels in door leaves and half-glazed and fully glazed door leaves, see SHTM 58: ‘Internal doorsets’);
- Width – the greater horizontal dimension;
- Height – any vertical dimension;
- Thickness – a dimension in any plane which is small compared to other dimensions, or the least overall horizontal dimension of a frame member;
- Basic space – a space bounded by reference planes assigned to receive a building component or assembly, including allowance for joints and tolerances;
- Coordinating size – the size given to a basic space;
- Work size – the size of the unit or opening to which its actual size should conform within specified permissible deviations. These terms are illustrated in Figure 1.

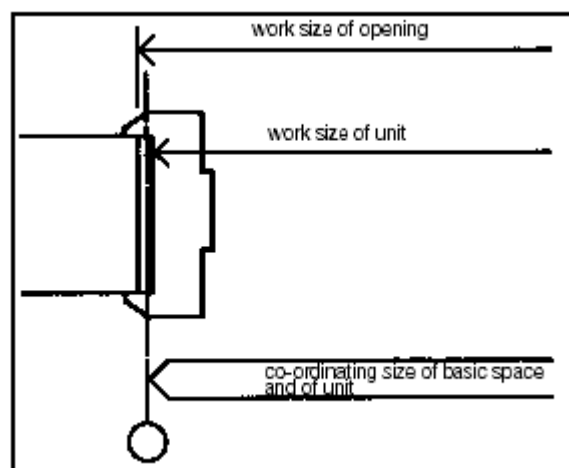


Figure 1

2. Design and specification guidance

General

- 2.1 Internal glazing will be required in health buildings to:
- relate and extend space visually while providing a barrier to physical movement, sound and airborne infection;
 - facilitate observation and supervision of patients;
 - provide borrowed light.
- 2.2 User requirements should be assessed to determine the type and extent of internal glazing necessary for these purposes and should include consideration of:
- sight lines for observation;
 - resistance to impact damage and breakage, and fail-safe requirements when this occurs;
 - fire precautions;
 - sound insulation;
 - X-ray resistance;
 - security;
 - privacy and dignity issues;
 - acoustics.

Description of units

- 2.3 The size, type and configuration of internal glazing units should be determined by user requirements, location and appearance. For example, glazing in a compartment wall adjoining a hospital street can be floor-to-ceiling, but special conditions apply for escape, handrails, privacy etc.
- 2.4 Internally glazed partitioned units may be specific to individual partition manufacturer systems.

Glazing

- 2.5 All internal glazing should comply with the requirements of the current Building (Scotland) Regulations 2004 and BS 6262 'Code of practice for glazing of buildings'.

- 2.6 For safety reasons, glazed units which are below 2,100mm from the finished floor level (FFL) and which are not designated as fire-resisting should be glazed with safety glass.
- 2.7 In fire-resisting situations generally, glazing should be in fire-resisting glass. Where below 2,100mm, this should also provide a level of safety performance. In fire-resisting situations in protected shafts, escape routes etc, glazing should be in fire-resisting glass which possesses safety performance and which may also need to provide insulation against heat/radiation.
- 2.8 All glazing above 2,100mm, whether designated fire-resisting or not, should be glazed with 6mm Georgian wired or other fire-resisting glass to reduce the risk of breakage from raised temperatures in a fire.
- 2.9 The Building (Scotland) Regulations 2004 set out various criteria for fire-resistance, means of escape, visibility and safety for glazing. These requirements can result in complex criteria for the specification of glass.
- 2.10 Safety glasses are not necessarily fire-resisting. Fire-resisting glasses are not necessarily safety glass or capable of giving insulation. Glass capable of meeting several of these requirements is available, but is expensive.
- 2.11 Non-fire-resisting safety glass should be toughened or laminated and comply with the appropriate levels required by the Building (Scotland) Regulations 2004 and those set out in BS 6206 'Specification for impact performance requirements for flat safety glass and safety plastics for use in buildings'.
- 2.12 Where fire-resisting glass is required, panes of Georgian safety wired glass should be used, except where 'small panes' of ordinary wired glass are permitted. In other cases the glass may also be required to possess insulating properties.
- 2.13 Security glazing may be required to prevent unlawful entry and resist vandalism, and may also be used in secure areas such as mental health accommodation. To meet these requirements, laminated glass or plastics glazing should be specified.
- 2.14 Plastics glazing materials may be used in security or vandal-resistant situations. These should not be specified where fire-resistance is required.
- 2.15 SHTM 69: 'Protection' gives advice on reducing the incidence and degree of damage.
- 2.16 Where sound insulation is required, two panes of glass (with a suitable air space between) or a single pane of thick glass should be used. Glass must be sealed to prevent the passage of sound.

Glass types

Annealed flat glass

- 2.17 Annealed glass is 'ordinary' glass which "*has been subjected to controlled cooling to reduce the presence of residual stresses in the glass; thus allowing easy cutting*". It includes float glass, cast glass and wired glass.
- 2.18 When tested to BS 6206:1981, 6mm annealed (soda lime) flat glass and ordinary wired glass do not achieve a classification.
- 2.19 Wired glass is available as cast, polished and safety types. Wired safety glass has a stronger wire interlayer and achieves Class C when tested to BS 6206:1981.

Processed flat glass

- 2.20 This includes toughened (tempered) glass and laminated glass.
- 2.21 Toughened (tempered) glass is either fire-resisting toughened glass (this is a modified type, edge treated), or borosilicate glass (this is fire-resisting). It is toughened by reheating after cutting to size and is approximately five times stronger than a similar thickness of annealed glass. When broken, it breaks into small fragments which are less likely to cause injury. It achieves Class A when tested to BS 6206:1981.
- 2.22 Laminated glass comprises two layers of glass with a layer of polyvinyl butyral or cast-in-place resin between. Safety, security, solar control and wired safety glasses are available, plus insulating or intumescent- interlayer glazing.
- 2.23 If the glass is broken, the fragments are held together by the plastics core. This glass can be cut to size from stock material. Classifications of A, B and C can be achieved according to type and thickness of laminated glass.

Glass blocks

- 2.24 Glass blocks are frequently used as an alternative to clear glazing. They are available in several thicknesses as hollow blocks and as solid blocks. Glass blocks can be a substitute for windows (where ventilation is not required) or as a partition or divider screen.

Finishes

- 2.25 A wide range of frame finishes are available including paint, stain, clear finish and PVC. Where paint finish is specified the units will normally be supplied from the factory with a priming coat only, the remaining coats being applied on-site. Stain and clear finishes are normally applied in the factory.

- 2.26 Finishes should be selected with full consideration of capital costs and subsequent maintenance costs.
- 2.27 Clear-coated finishes may be difficult to maintain, particularly in respect of scratching and minor impact damage where the coating has been penetrated.
- 2.28 Painted finishes are easier to maintain by filling scratches and minor impact damage and repainting.

Resistance to marking

- 2.29 When tested in accordance with BS 3962:1980 Parts 5 & 6, BS EN 12720:1997, BS EN 12721:1997 and BS EN 12722:1997, the surface treatment of factory-finished units should have a resistance rating of less than 3.

Hygiene and cleaning

- 2.30 Control and Prevention of Healthcare Associated Infection (HAI) is a priority issue for NHSScotland, both in respect of the safety and well being of patients and staff and also the resources consumed by potentially unavoidable infections.

Healthcare Associated Infection (HAI) is a complex issue involving the many different elements of patient care and provision. Due to its multi-factorial nature there is a need to develop a holistic approach to combating the spread of infection within the built environment.

It is imperative that those involved in the design and planning, construction and refurbishment and on-going maintenance of the healthcare facility have a sound knowledge of prevention and control of infection in the built environment.

Scottish Health Facilities Note (SHFN) 30 and HAI-SCRIBE aim to provide information on the prevention and control of infection, and on the prevention of cross-infection and cross contamination in healthcare facilities, to those responsible for the planning, design and maintenance of such facilities.

Cleaning is an essential part of the multi-disciplinary approach in improving patient, staff and public safety. Safe clinical care is supported through ensuring high standards of hygiene and related measures to tackle HAI in the healthcare environment.

Cleaning regimes including frequency of cleaning should be addressed in line with current national guidance together with any additional local management requirements.

Relevant provisions of current guidance, standards and Codes of Practice for cleaning of healthcare premises and including the latest technical requirements are embodied in the following documents:

- SHFN 30: 'Infection Control in the built environment: Design and Planning';

- HAI-Scribe (Healthcare Associated Infection System for Controlling Risk in the Built Environment);
- The NHSScotland National Cleaning Services Specification;
- NHS Quality Improvement, Scotland – Healthcare Associated Infection (HAI) Cleaning Services Standards;
- The NHSScotland Code of Practice for the Local Management of Hygiene and Healthcare Associated Infection;
- Clinical Standards Board for Scotland Healthcare Associated Infection (HAI) Infection Control Standards.

2.31 All units, including those with site-applied finishes, should be capable of withstanding the cleaning regimes specified in the above specifications.

Observation

2.32 In areas where patients need to be observed, the glass should be clear and should be sized and positioned to suit the needs of both staff and patients. Remember that users may be adults or children, both of whom may be ambulant or in wheelchairs, or standing, sitting or lying.

2.33 Where through-vision is required for wheelchair users, the minimum zone of visibility should be between 500 mm and 1,500 mm from the finished floor level.

2.34 Curtains should be considered where there is a conflict of interest between staff for supervision and patients' expectations of privacy.

Safety, strength and security

2.35 Glazing in buildings can be a potential danger, and care should be exercised in its selection and location.

2.36 Areas of greatest risk include glazing at low level and glazing in doors and sidelights. These are potential hazards and are highlighted in section 4.8 of the Building (Scotland) Regulations 2004.

2.37 The following precautions should be taken:

- use safety glass generally (this has been used for almost all non-fire-resisting glazing in hospitals for several years);
- ensure that glass can be seen;
- ensure that glass is protected from accidental damage from users and mobile equipment by positioning framing or barriers of sufficient size and strength where there is the risk of impact.

2.38 In mental health accommodation, glazing must be capable of withstanding deliberate attack by patients. Broken glass can be used for self-harm and as a

weapon to attack other patients and staff. The use of appropriate specifications of laminated or toughened glass and applied films to the surface of glass should be considered. Polycarbonate sheeting is an alternative product which will flex but will resist breakage. However, it has a more limited scratch resistance.

- 2.39 Thick annealed glass (8–15mm thick) is not recommended for use in health buildings, because if fractured by hard body impacts, such as those that might occur from hospital tugs and trollies, the glass breaks into dangerous, sharp and pointed pieces.
- 2.40 Suitable framing systems with appropriately sized members, glazing systems with intumescent seals, beads etc and appropriate glass sizes must be used with all glass types.
- 2.41 Long runs of glazed units may require additional strengthening of the mullions or studs to ensure structural performance in normal use and under-fire situations.
- 2.42 Glazed units constructed of metal or plastics should be validated by test evidence of fire and structural performance from the manufacturers of the units.
- 2.43 Glass panels to improve visibility can reduce the risk of collisions, for example at doorways, in door leaves and/or in sidelights, and enable smoke or flames to be observed.

Forces acting on glazing

- 2.45 Impact forces and pressures acting on glazing are not normally specified, as it is recognised that glass has a lower resistance to these forces than the constructions into which it is fitted.
- 2.46 Glazing can be easily designed to resist soft/heavy body impact forces, but glass is less resistant to impacts from point loads such as those that occur when glass is struck by sharp corners on unprotected hospital tugs, trollies or other wheeled equipment.
- 2.47 If possible, impacts on glazing should be avoided by the design of the framing etc or provision of barriers.
- 2.48 However, partitions and doors are required to resist impact forces and pressures, and these forces inevitably relate to any glazing in them.

Implications of the Building Regulations

- 2.49 The relevant requirements of the Building (Scotland) Regulations 2004 are generally satisfied by the recommendations in this SHTM and comprise the use of:
- safety glass, for non-fire-resisting situations; or

- 6mm Georgian wired glass for fire-resisting situations where 'small panes' are permitted;
- 6mm Georgian wired safety glass for fire-resisting situations where panes are from 250mm to 900mm wide;
- other safety/fire-resisting/insulating glass.

Critical locations

2.50 Critical locations in terms of safety are:

- between finished floor level and 800mm above that level in internal (and external) walls and partitions;
- between finished floor level and 1,500mm above that level in a door or in a side panel, close to either edge of the door.

Reducing the risks

2.51 Glazing in critical locations should either:

- break safely, if it breaks;
- be in small panes; or;
- be permanently protected.

Safe breakage

2.52 Safe breakage is defined in BS 6206:1981 and is based on the impact test which requires the result of the impact to be limited to creating:

- a small clear opening only, with a limit to the size of the detached particles; or
- disintegration, with small detached particles; or
- breakage resulting in separate pieces that are not sharp or pointed.

2.53 In terms of safe breakage, a glazing material suitable for installation in a critical location should satisfy the test requirements of Class C of BS 6206:1981 or, if it is installed in a door or in a door side panel and has a width exceeding 900mm, the test requirement of Class B of the same standard.

Glazing in small panes

2.54 A small pane may be an isolated pane or one of a number of panes contained within glazing bars.

2.55 Small panes should have a maximum width of 250 mm and an area not exceeding 0.5 m², each measured between glazing beads or similar fixings.

Annealed glass in a small pane should not be less than 6 mm nominal in thickness.

Fire precautions

- 2.56 The Building (Scotland) Regulations 2004 and associated provisions of Firecode indicate relevant requirements for fire resistance – stability and integrity of all building components.
- 2.57 Glazed units in corridors and protected shafts, in the limited situations permitted by the Building Regulations, and glazed panels in fire-resisting doors (see SHTM 58: 'Internal doorsets') are required to possess integrity only.
- 2.58 In some situations, glass panels, particularly in the lower half of partitions or doors, may also be required to possess insulation characteristics, as defined in BS 476:1987, or may not be appropriate.
- 2.59 Most types of glass do not achieve any significant rating for thermal insulation or resistance to radiation. These types of glass will not, therefore, reduce the risk of problems such as potential radiation hazards, the creation of an unbreathable atmosphere, or an outbreak of a fire in the space on the side of the glazing away from the source of the fire. These problems can be eased by the positioning and reduction in size of areas of glazing or by the use of special glasses which reduce radiation and provide insulation.

Specification

- 2.60 Where any glazed panels are to be glazed with special glass such as insulating, intumescent, modified toughened or borosilicate glass, the details should be discussed with the glass manufacturers, as modified edge details may be required.
- 2.61 Internal glazing should be designed and constructed to resist the passage of smoke wherever possible, but always where glazed units are adjacent to or in the same run of partition as smoke-resisting doorsets. This requires that the gaps between frames and adjacent construction and between glazing beads and the glass be made airtight by the use of suitable sealing materials.
- 2.62 Proprietary systems of glazing and special glasses should be validated by appropriate test data.

Fire-resisting glazing materials

- 2.63 The most widely used glass for fire-resisting panels in screens, borrowed lights, and doors and sidelights is 6 mm Georgian wired glass. It can provide up to 90 minutes fire resistance in suitable sizes, framing and glazing systems.
- 2.64 Generally, where glass panels are not more than 900 mm wide, 6 mm Georgian wired safety glass, which gives both fire resistance and Class C impact

performance to BS 6206:1981, should be used. It is available at a slight additional cost. For 'small panes', 6 mm 'ordinary' Georgian wired glass may be used.

- 2.65 Other special fire-resistant glazing materials are available providing:
- resistance to fire and resistance to impact of BS 6206:1981 Class B; or
 - resistance to fire and insulation/protection from radiation; or
 - resistance to fire, insulation and impact. These characteristics may be required for glazed screens to escape routes etc.
- 2.66 These special materials include special types of laminated glass, modified toughened glass and borosilicate glass. They are much more expensive than 6 mm wired glass, and usually require special framing and glazing systems.
- 2.67 Specialist guidance on their performance and installation should be obtained from the glass manufacturers or from the Fire-resistant Glass and Glazed Systems Association (FRGGSA).
- 2.68 Plastics glazing materials may be used in security or to deter vandalism, however, these should not be specified where fire resistance is required.

Sound insulation

- 2.69 The sound insulation performance of a partition will be reduced where the partition is penetrated by a glazed opening, and the need for internal glazing should be balanced against such a reduction.
- 2.70 Double glazing or thicker glass should be used where sound insulation is an important consideration.
- 2.71 Sound leakage should be avoided by sealing glass into the frame and by filling gaps between frame and partition with sound-absorbent material.
- 2.72 To achieve optimum sound reduction, the air space in double glazing should be a minimum of 100 mm and should be lined with sound-absorbent material.
- 2.73 Guidance on levels of sound insulation that can be achieved with partitions is given in SHTM 56: 'Partitions' and SHTM 2045: 'Acoustics'.

Hygrothermal performance

- 2.74 The hygrothermal conditions in which units are installed can materially affect their appearance and performance.
- 2.75 Normal conditions likely to be met in health buildings are:
- 25% to 65% relative humidity over a temperature range of 10°C to 25°C.

2.76 In areas of high humidity, such as laundries and shower rooms, the conditions would be:

- 25% to 100% relative humidity over a temperature range of 10°C to 30°C.

2.77 Internal glazing units should be able to withstand these conditions without loss of appearance or performance.

X-ray resistance

2.78 Internal glazing should not be provided in the enclosing walls to X-ray diagnostic or treatment rooms (see Scottish Health Planning Note 06 (SHPN): 'Facilities for diagnostic imaging and interventional radiology').

2.79 Where there is a need for protective glazed screens within the room for observation by staff, they should comply with the requirements of the local Radiological Protection Adviser and may be obtained from specialist manufacturers.

2.80 Doors to X-ray rooms may have vision panels (see SHTM 58: 'Internal doorsets').

Maintenance manual

2.81 An operation and maintenance manual should be compiled and should be handed to the maintenance staff immediately following the practical completion of the contract.

2.82 Internal glazing units should be cleaned and disinfected at regular intervals in accordance with the specifications outlined in [paragraphs 2.30–2.31](#).

2.83 Broken or damaged glass should be replaced without delay, particularly in the case of fire-resisting units where the performance of the unit must be maintained at all times (see [paragraphs 2.5–2.23](#) for method of glazing). Intumescent strips in fire-resisting glazing should be inspected regularly and replaced if damaged.

References

Acts and regulations

(The) Building (Scotland) Regulations 2004. ISBN 0 954 6292 3xRef Scottish Building Standards Agency

Construction (Design and Management) [CDM] Regulations. HMSO, 1994.
www.hmso.gov.uk/si/si1994/Uksi_19943140_en_1.htm

Activity DataBase <http://adb.dh.gov.uk/>

NHSScotland Publications

SHPN 6: 'Facilities for diagnostic imaging and interventional radiology'. Part 2–3. Health Facilities Scotland (formerly NHSScotland Property and Environment Forum), 2005

SHTM 58: 'Internal doorsets': Health Facilities Scotland, 2006

SHTM 69: 'Protection': Health Facilities Scotland, 2006

SHTM 2045: 'Acoustics': Health Facilities Scotland, 2006

SHFN 30: 'Infection Control in the built environment: Design and Planning' Health Facilities Scotland, 2007

HAI-Scribe (Healthcare Associated Infection System for Controlling Risk in the Built Environment): Health Facilities Scotland, 2007

The NHSScotland National Cleaning Services Specification: SEHD / CMO (2004) 8

NHS Quality Improvement, Scotland – Healthcare Associated Infection (HAI) Cleaning Services Standards: CSBS / NHSQIS. 2002 ISBN 1 903766 12 5

The NHSScotland Code of Practice for the Local Management of Hygiene and Healthcare Associated Infection: Healthcare Associated Task Force CMO (2004) 09

Clinical Standards Board for Scotland Healthcare Associated Infection (HAI) Infection Control Standards: December 2001 CSBS 2001 ISBN 1-903766-12-5

British Standards

BS 476-20:1987 Fire tests on building materials and structures. Method for determination of the fire resistance of elements of construction (general principles). British Standards Institution, 1987.

BS 476-22:1987 Fire tests on building materials and structures. Methods for determination of the fire resistance of non-loadbearing elements of construction. British Standards Institution, 1987.

BS 3962-5:1980 Methods of test for finishes for wooden furniture. Assessment of surface resistance to cold oils and fats. British Standards Institution, 1980.

BS 3962-6:1980 Methods of test for finishes for wooden furniture. Assessment of resistance to mechanical damage. British Standards Institution, 1980.

BS 6206:1981 Specification for impact performance requirements for flat safety glass and safety plastics for use in buildings. British Standards Institution, 1981.

BS 6262:1982 Code of practice for glazing of buildings. British Standards Institution, 1982.

BS EN 12720:1997 Furniture. Assessment of surface resistance to cold liquids. British Standards Institution, 1997.

BS EN 12721:1997 Furniture. Assessment of surface resistance to wet heat. British Standards Institution, 1997.

BS EN 12722:1997 Furniture. Assessment of surface resistance to dry heat. British Standards Institution, 1997.

Trade associations

Fire Resistant Glass and Glazed Systems Association (FRGGSA). 20 Park Street, Princes Risborough, Bucks HP27 9AH. Tel: 01844 275500; Fax: 01844 274002.